

NON-FREEZE ROOF HYDRANT



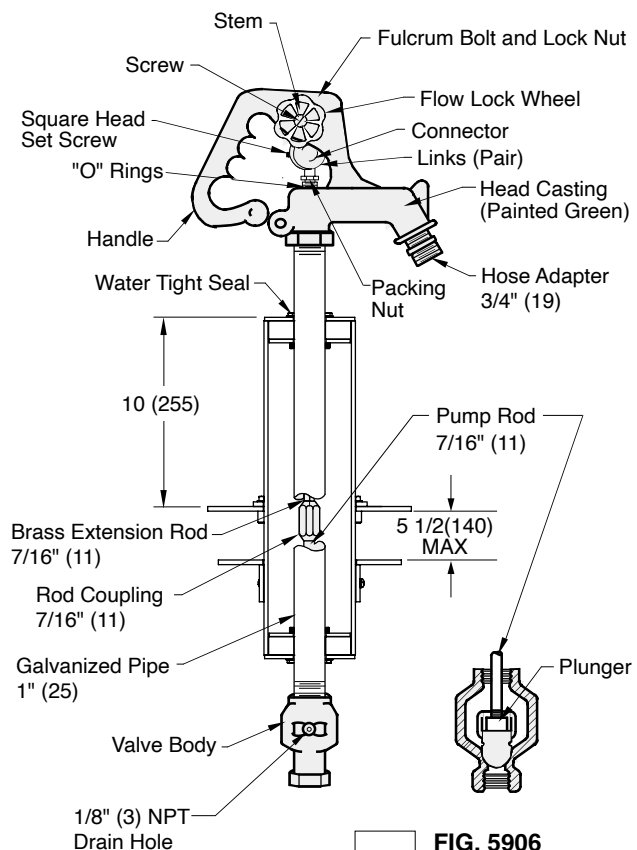


FIG. 5906

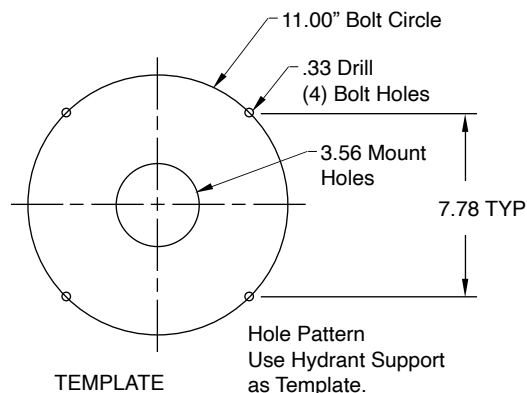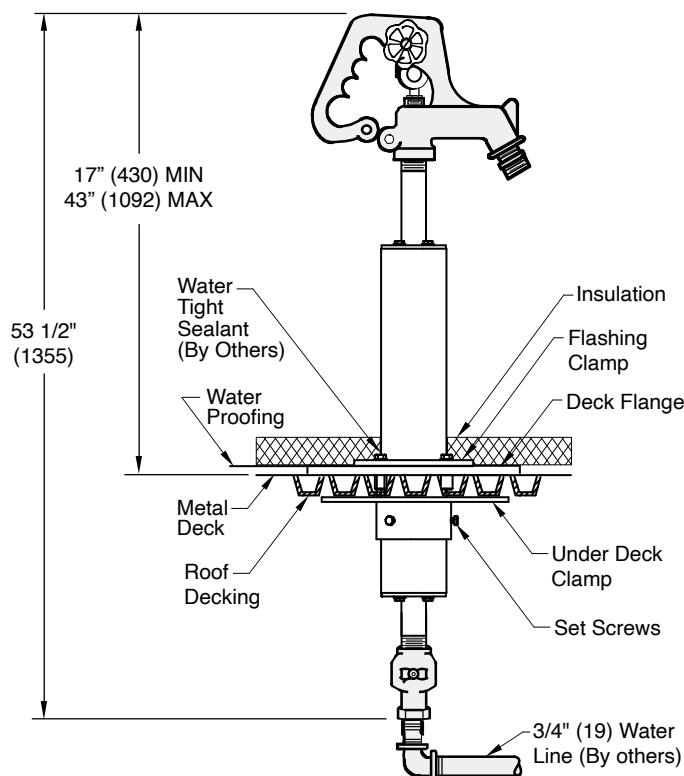

TEMPLATE

Hole Pattern
Use Hydrant Support
as Template.

- NOTE: 1.** Drain Hole must be piped and discharged to an acceptable discharge point. Failure to do so will result in potential water damage which Smith is not responsible.
2. Hose must be removed to allow proper draining of the casing. Smith is not responsible for any casings that burst or related incidents if the hose is not removed.
3. Dimensions shown in parentheses are in millimeters.
4. The AB100, AB1953, California Lead Law, and NSF/ANSI Standard 61- Drinking Water System Components are not applicable to Jay R. Smith hydrants as they do not convey/dispense water for human consumption through drinking or cooking.
5. **FOR IRRIGATION PURPOSES ONLY.**

REGULARLY FURNISHED:

Non-Freeze Roof Hydrant with Galvanized Casing and Adjustable Flow Wheel Lock Handle with Deck Flange and Under Deck Clamp.

VARIATIONS:

☐ Vacuum Breaker -H (Note 2)

N M L K	8-4-23 3-22-23 1-18-23 3-10-21	Removed Function Added Notes 4 & 5/Removed ASL/TL Updated Truesdail Note Removed Note	HS KK KK KK	CL JT CL JM	WEIGHT POUNDS	VOLUME CUBIC FEET	FIGURE NUMBER 5906
REV.	DATE	DESCRIPTION	BY	CKD. BY			



WARNING: Cancer and Reproductive Harm - www.P65Warnings.ca.gov